


**PLYWOOD SHEATHING & DECK CONSTRUCTION RECOMMENDATIONS**

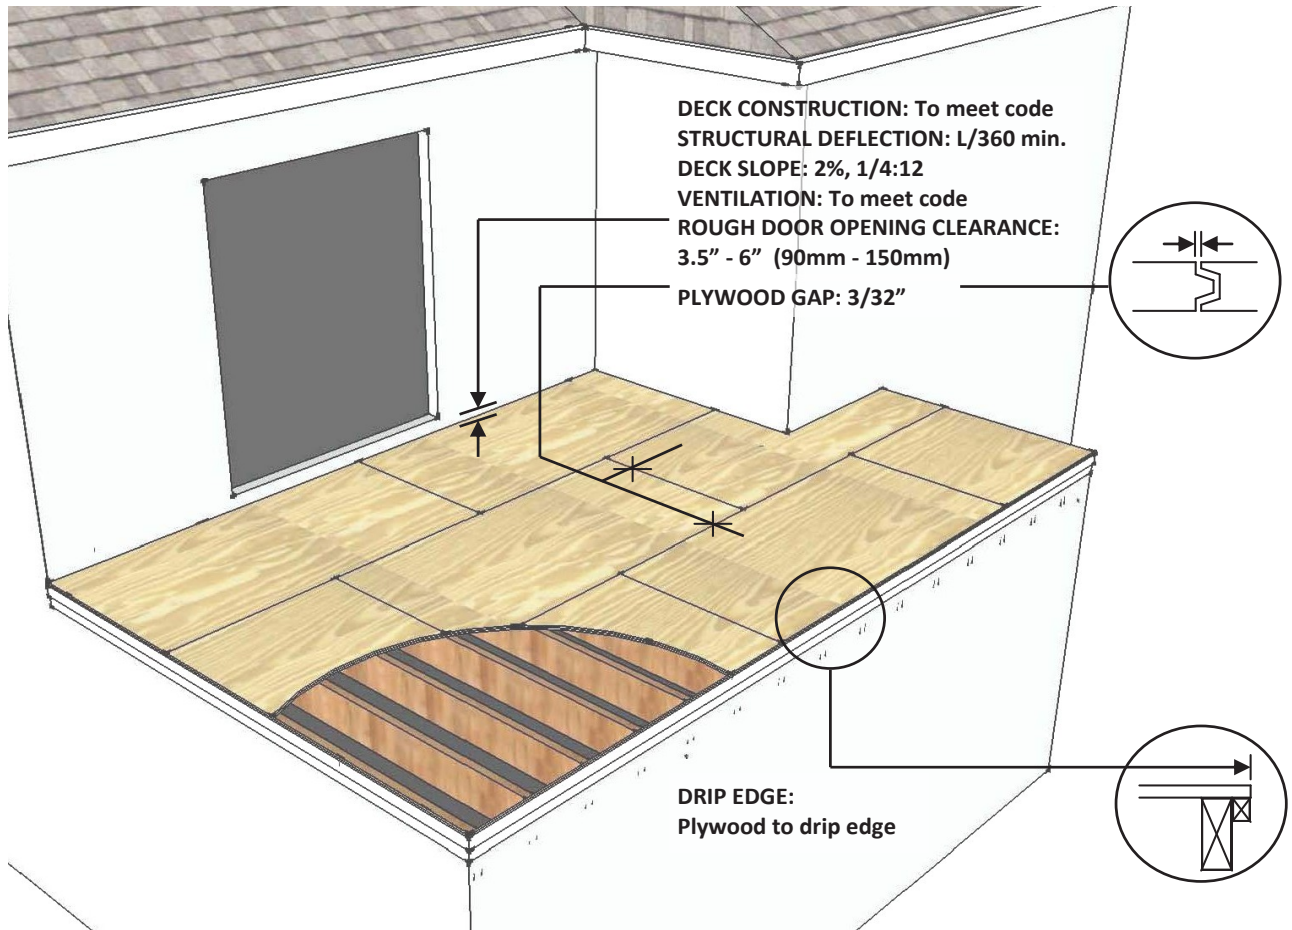

**PLYWOOD REQUIREMENTS:**

**CANADA:** Trademark Stamp – CANPLY (Canadian Plywood Association)  
Standards – Douglas Fir (FIR) CSA O121 – DFP & Canadian Softwood (SPF) CSA O151 - CSP

Property	Recommended Plywood	Acceptable Plywood
Thickness	3/4" (18.5mm) over joists @ 16" (400mm) o.c.	5/8" (15.5 mm) over joists @ 16' (4.00mm o.c)
Grade	Easy T&G – Floor, Select Tight Face (SEL TF)	Easy T&G – Floor, Select (SEL)
Species	Douglas Fir (FIR)	Canadian Softwood (SPF)
Exposure Durability	Exterior	Exterior

**Fasteners:** Recommend 2" #10 exterior wood deck screw either stainless steel or coated with non-staining finish. 2 1/2" hot dipped galvanized ring thread or spiral nails acceptable for 5/8" & 3/4" panels but should be driven in at a slight angle to reduce nail pops. Slightly recess all fastener heads.

**Fastener Spacing:** Space fasteners 6" (150mm) o.c. along edges and 8: (200mm) o.c. along intermediate supports.

**UNACCEPTABLE SUBSTRATES**

Poplar plywood, orientated strand board (OSB), particle board, luaun, panels with medium density overlay (MDO) or high density overlay (HDO), treated plywood (ie: fire treated, pressure treated or panels with field and/or edge sealants) either factory or field applied are not recommended.

**If Duradek is installed on a substrate that is not listed above as recommended or acceptable, the material warranty may be voided and not enforceable. Issues arising from improper substrates, improper slope, substrate movement or deflection, etc. are specifically excluded from the Duradek warranty. Please refer to the written warranty for further information.**

*See reverse side for more information.*

**duradek**

General Note: Duradek does not supply framing & sheathing products. Always refer to manufacturer’s written instructions & the requirements of authority having jurisdiction before building or altering a deck.

**DECK DESIGN & CONSTRUCTION**

**Structural Design:** to governing building code requirements. Framing Lumber: Install Kiln-dried lumber with crown sides up.

**Deflection:** minimum allowable deflection of L/360 Joist Spacing: 16” (400 mm) o.c. recommended.

**Slope:** 1/4” per foot (2%) positive slope is required to prevent standing water.

**Door Openings:** Recommend rough door openings to be 3.5” to 6” (90mm to 150mm) above elevation of finished deck. Lower rough openings, as required for handicapped accessible doors (see Duradek detail IS-04), are acceptable. For a comprehensive waterproofing system, the membrane is to be applied into the rough door opening.

**Ventilation:** of roof joist space or unconditioned areas like crawl spaces to meet governing building code requirements. Adequate ventilation should be provided to the underside of a sundeck when built close to finished grade.

**Drains:** place drain(s) at points of maximum deflection, not over columns, beams etc. Any required overflows should be placed in close proximity to the drain(s) and located no more than 2” (50 mm) above the deck surface or lower than any building opening.

**PLYWOOD INSTALLATION**

**Delivery/storage/handling:** Avoid damaging plywood panels especially edge surfaces when handling. Store panels in a sheltered place, stacked, separated & with no direct contact with the ground.

**Moisture Content:** Ideal moisture content of plywood is 12-14% @ 70% relative humidity / 68 deg. F (20 deg. C). To achieve desired MC for new plywood, store panels for 7 days (minimum of 48 hours) as noted above.

**Placement:** Plywood panels to be installed with the surface grain at right angles to the joists. Install first row of plywood at building side with the “tongue” facing the building. Remove the tongue for tight fit. End joints shall be supported over 2” wood joists. At unsupported joints, install 2” x 4” blocking securely nailed between framing members. Nail or screw plywood in place. Stagger end joints in each succeeding row. Center panels over load bearing beams, walls etc to reduce ridging. Panels to span 3 joists min. At outside drip edge extend plywood to finished line of deck including trims, fascia boards, etc.

**Gap:** 3/32” (2.38 mm) @ side & end joints of panels.

**Fasteners:** Recommend 2” #10 exterior wood deck screw either stainless steel or coated with non-staining finish. 2 1/2” hot dipped galvanized ring thread or spiral nails acceptable for 5/8” & 3/4” panels but should be driven in at a slight angle to reduce nail pops. Slightly recess all fastener heads.

**Fastener Spacing:** Space fasteners 6” (150mm) o.c. along edges & 8” (200mm) o.c. along intermediate supports.

**Panel Adhesive:** Do not apply panel adhesive at any plywood joints. Can be used between plywood panels & joists.

**OTHER SUBSTRATE REQUIREMENTS**

**Two Layer Subfloor**

Two-layer subfloor system is recommended when covering an existing panel that is not a suitable substrate or to achieve a Class “A” rated roof assembly. Do not apply new top layer panel over an existing waterproofed/sealed base layer. Existing membrane/sealer must be removed and a new substrate provided.

Recommended Underlayment	Acceptable Underlayment
3/4” (18.5mm) T&G plywood: refer to “Recommended” plywood specifications	5/8” (15.5mm) T&G plywood: refer to “Acceptable” plywood specifications
Cement board: min. 1/4” (6.4 mm) installed per manufacturer’s specifications <i>This will achieve Class ‘A’ fire rating substrate requirements Duradek’s ICC-ES Report (ESR-2151)</i>	

**Two Layer Subfloor Installation:** Base layer to be installed as per single layer subfloor instructions as noted above. Top layer to be installed parallel to base layer but offset 1/2 panel in both directions. Fasteners, types as noted above, to be of sufficient length to penetrate deck framing at least 1” (25mm). Water based construction adhesive (only) can be used between panel layers.

**Wall/Parapet/Curb Sheathing requirements:** Duradek membranes to be bonded to a suitable substrate at all vertical applications & at perimeter details. Membrane can be bonded to untreated dimensional lumber at rough door sill or at curb if the membrane is to be later covered with metal flashing or wood trim.

Acceptable Wall/Parapet/Curb Sheathing
1/2” (12.5mm) plywood: refer to “Acceptable” plywood specifications

**PLYWOOD SURFACE PREPARATION**

- Sand all plywood joints and rows of fasteners with a floor edger or belt sander.
- Install any necessary flashing trim being sure that they will not impede the flow of water (recessing drip edge using a planer is best practice).
- Spot fill all knotholes, depressions, damaged areas and at flashing trims with either approved floor patch.
- Fill plywood joints as needed.
  - If plywood moisture content is less than 12%: do not fill any gaps.
  - If plywood moisture content is 12% or higher: do not fill gaps 1/16” or less. Double fill gaps 3/32” or more.
  - Membrane may settle into gaps larger than 3/32” which could show under some lighting conditions
- Sand all areas that leveler was applied once it has dried.
- Synthetic patches must be removed & filled with floor patch or painted with 2 coats of an approved sealer/stain blocker. Wood veneer patches, pitch pockets, pitch streaks, red chalk, ink, construction adhesive, wood filler, etc. must also be sealed with 2 coats of an approved sealer/stain blocker.
- Use a whiskbroom or powered blower to clean off all debris. Do a final inspection to ensure the deck is suitable for the application of the Duradek membrane. The deck is accepted as being suitable once the membrane installation commences.
- Installed Spruce-Pine-Fir (SPF) panels should be waterproofed immediately as they are more prone to face checking when left exposed to the elements. Protect plywood from rain & snow after installation to prevent moisture pickup. Do not place tarps directly on wood. Use sleepers under tarps to allow for air movement.